



Industrial Manufacturer's Office HVAC Noise Inspires Industry's First Fabric Duct Attenuator

Noise polluting HVAC mechanical noise at Mi-T-M Corp. is abated with Silencer™ by DuctSox that promises quieter workplace ambience.

Peosta, Iowa—Industrial equipment manufacturer Mi-T-M Corp. inspired the world's first fabric ductwork sound attenuator when its new 68,000-square-foot office building experienced noise from mechanical air handling units (AHU) supplying the facility's HVAC.

The two-story, free-standing building replaces smaller spaces and now consolidates most of Mi-T-M's office employees under one roof at its Peosta, Iowa 30-acre campus headquarters. Despite its state-of-the-art concrete and tilt-up wall construction, the facility still suffered interior ambient HVAC mechanical noise issues.


Like nearly 300,000 of Mi-T-M's 800,000-square feet of industrial space, the office complex uses fabric duct air distribution. Mi-T-M CEO A.J. Spiegel's HVAC ductwork material preference for years has been fabric duct, because of its aesthetics and its installation labor savings versus metal duct. Spiegel has requested it in several past campus building projects, a local restaurant, event center, Baymont Inn swimming pool, Bellevue, Iowa, and the 70,000-square-foot Peosta Community Centre, the latter which was donated to residents.

Unlike metal duct, the fabric duct industry had yet to develop attenuation because the comparably softer surfaces of fabric duct were proven to reverberate less mechanical equipment noise than their metal counterparts. At Mi-T-M's offices however, very high ambient sound affected inter-cubicle and telephone conversations. "After our first month we decided on somehow abating the mechanical noise," said Thomas Allendorf, managing director of operations, Mi-T-M, a leading international manufacturer of pressure washers, air compressors and many other industrial products, many of which are OEM or private labeled.

Michael Wuertzer, Mi-T-M's plant maintenance supervisor, attempted to attenuate mechanical noise by lowering AHU airflow by 60 percent with the AHUs' built-in variable frequency drives. When noise

was not reduced to acceptable levels, Wuertzer and Allendorf requested fabric duct manufacturer, DuctSox Corp., Peosta, Iowa, to develop the world's first sound attenuator for fabric air dispersion systems.

The building is designed with 1,388-linear feet of DuctSox's premium grade Sedona-XM fabric duct, which includes a built-in anti-microbial agent to prevent biological growth. Although the majority of the 20 duct runs are 22-inch-diameter, some runs are 18 and 24-inch-diameter duct along with an occasional elbow or tee for air distribution coverage purposes. The silver fabric duct is suspended with DuctSox's patented SkeleCore Fabric Tensioning System (FTS), an aluminum metal hoop and center spacer tubing system. The system allows installing contractors to quickly and easily field-adjust the textile tautness and roundness

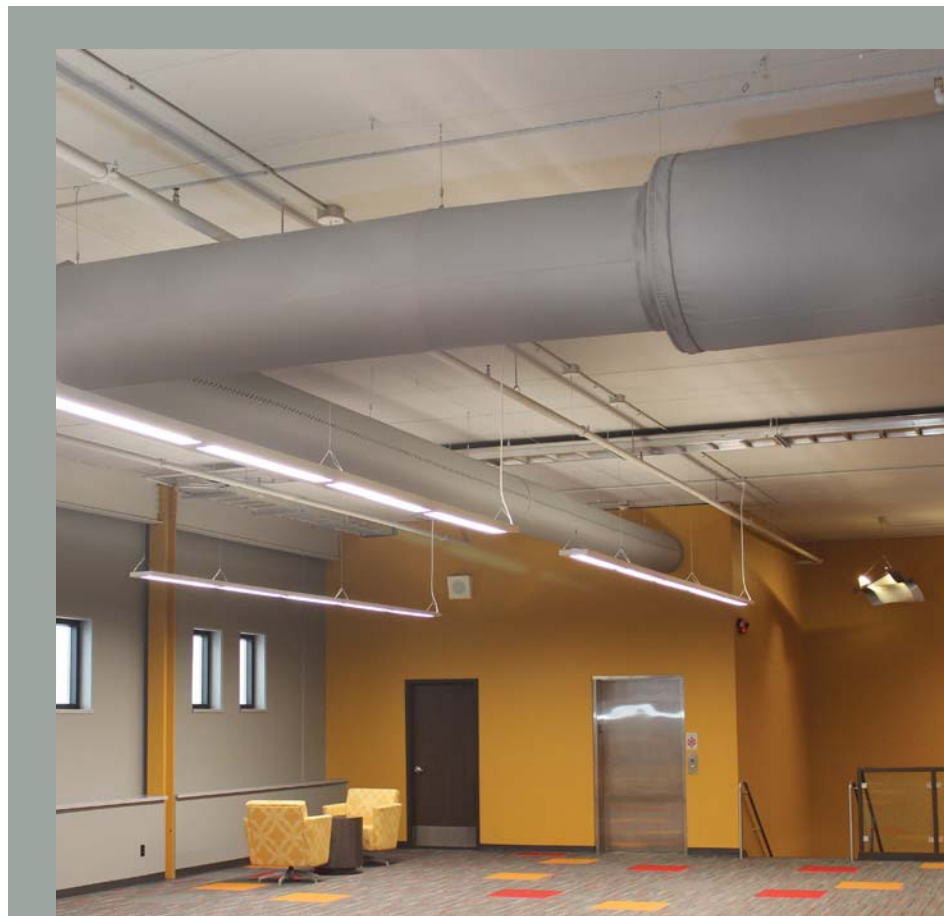



with just a turn of a wrench for wrinkle-free aesthetics. The result is fabric duct that appears inflated regardless of AHU operation or air pressure, which add to the office areas' aesthetics.

True to the Spiegel's impetus for using fabric duct on the project, 60 to 65-percent of the ductwork installation costs were saved versus using spiral-round metal duct, according to Russ Meyer, president of Meyer Mechanical, Dyersville, Iowa, a 66-year-old, employee-owned and operated HVAC, plumbing and electrical contractor. Meyer Mechanical was the project's design/build contractor that also installed all the HVAC systems.

The mechanical noise needing abatement was generated by a combination of airflow noise common in all types of ductwork and most of the building's 14 AHUs ranging from 2,625 to 4,400-cfms. The AHUs are supplied by one 220-ton chiller; and four 550,000-BTU, 94-percent-efficient boilers. Other mechanical equipment included four two-ton mini-split systems to redundantly cool computer and other smaller electronics rooms.

DuctSox's R&D department developed a fabric sound attenuator system, the Silencer that was successfully tested by Intertek Labs under ASTM-E477-2013 criteria, a standard laboratory measurement of acoustical and airflow performance of duct liner materials and pre-fabricated silencers. Sound pressure level data was obtained using a using a Bruel and Kjar pulse analyzer. JGL Acoustics Inc., a third-party laboratory, reviewed the results. Lab findings revealed the fabric attenuator with a center bullet sound absorber, which attaches to the in-duct tensioning system's spacer tubing, was equally effective in dynamic insertion loss (db) as metal sound attenuators up to 500-Hz and more effective than metal in the 500 to 8,000-Hz range. It was also beta-site tested at Mi-T-M's offices where noise levels dropped 15 db, an exponential calculation representing a decrease of more than 50 percent, according to Wuertzer.



The fabric sound attenuator is 48-inches-long and 30-inches-wide--eight inches wider than its accompanying 22-inch-diameter duct to accommodate the four-inch-wide double wall of sound-absorbing rock wool. The attenuator also offers an optional bullet centerpiece or it can come without a bullet, the former which was specified at Mi-T-M. Static pressure decreases for a 1,000-fpm example is 0.02-wg. and 0.05-wg. for the non-bullet and bullet versions, respectively. The attenuator is available in diameters ranging from 12 to 30-inches and is installed in-line where the inlet of fabric duct meets connecting metal ductwork from the AHU.

While the space is designed to meet future office staff growth and is currently partially occupied, Mi-T-M has complete flexibility to zipper in an attenuator to unoccupied area duct run when and if it's needed.

DUCTSOX[®]
Textile Air Dispersion Products

9866 Kapp Court • Peosta, IA 52068
Ph: 866-382-8769 • Fax: 563-588-5330

www.ductsox.com